






NOTE: CONTROL JOINTS SHALL BE INSTALLED TO DIVIDE LONG NARROW AREAS OF GYPSUM WALLBOARD, SUCH AS OCCUR ON CORRIDOR CEILINGS, INTO LENGTHS OF NOT MORE THAN 16 FEET AND SHALL BE INSTALLED AT EXPANSION OR CONTRACTION JOINTS IN THE STRUCTURAL FRAMEWORK OVER WHICH GYPSUM BOARD IS REQUIRED. CONTROL JOINTS FOR WALLS SHALL BE INSTALLED AS DETAILED ABOVE WITH DUST MEMBRANE AND METAL CASING BEADS APPLIED TO TWO WALL STUDS OR FURRING MEMBERS SPACED 1/8" APART. ALL CEILING AND WALL JOINTS SHALL BE INSTALLED WHERE SHOWN ON THE ARCHITECTURAL WALL ELEVATIONS AND THE FLOOR AND REFLECTED CEILING PLANS.

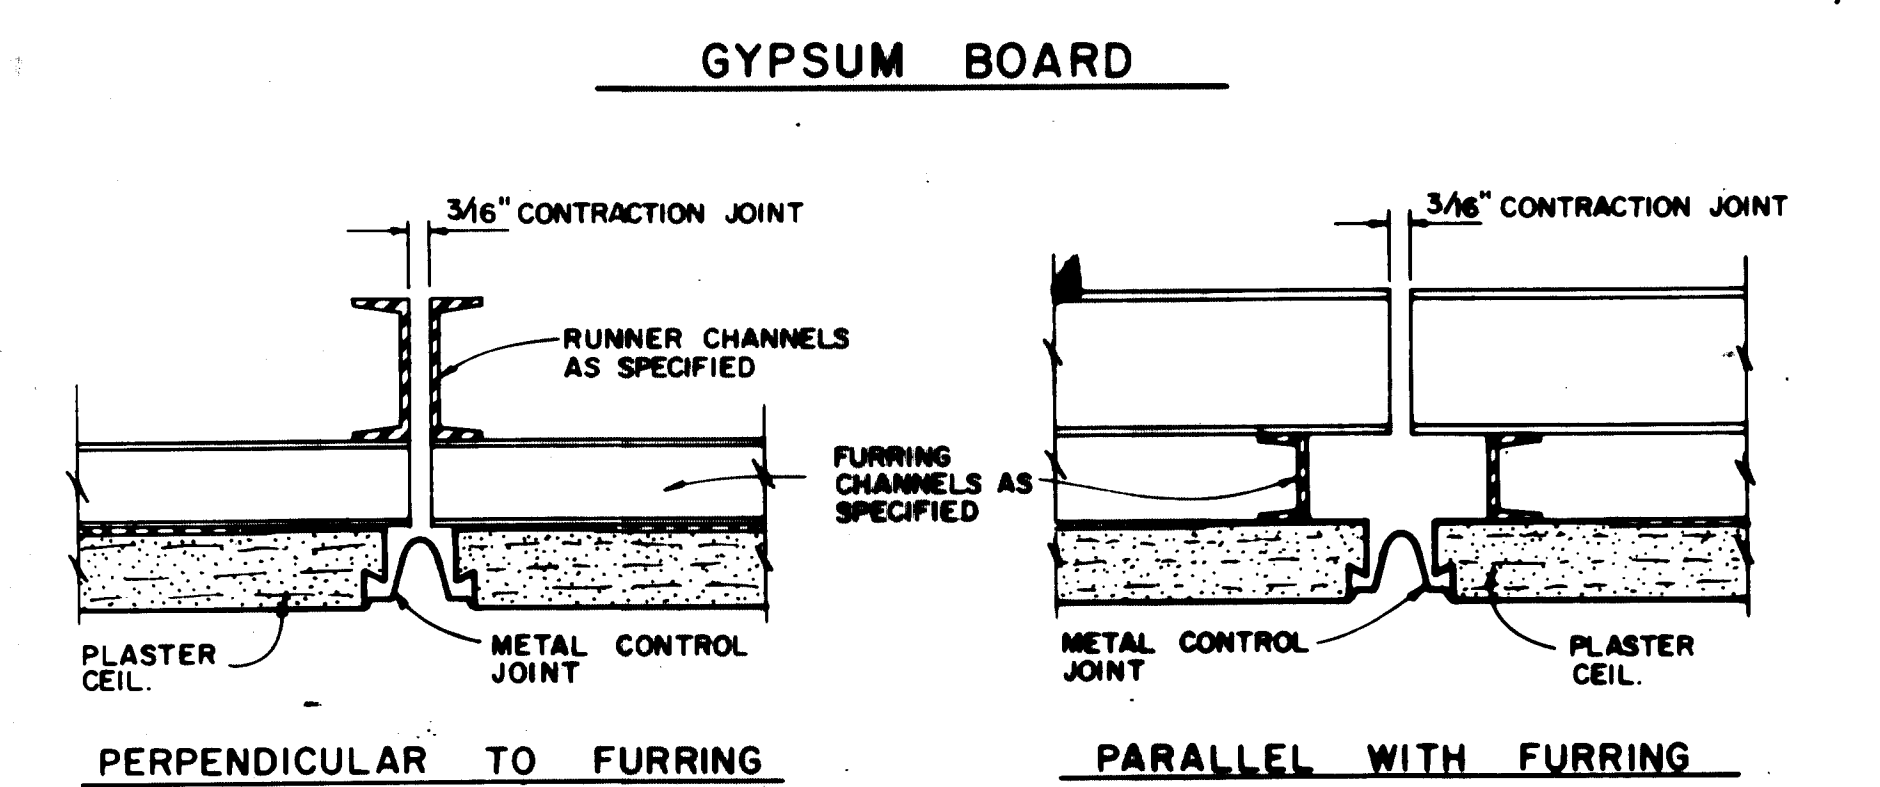

NOTE: CONTROL OR EXPANSION JOINTS IN PLASTER WORK SHALL BE INSTALLED TO CONTINUE EXPANSION OR CONTROL JOINTS IN STRUCTURAL FRAME AND TO DIVIDE PLASTER AREAS INTO NOT MORE THAN 144 SQUARE FEET FOR PORTLAND CEMENT PLASTER AND 300 SQUARE FEET FOR GYPSUM OR LIME PLASTER. INTERVAL BETWEEN JOINTS SHALL BE REDUCED IN LONG NARROW AREAS SUCH AS CORRIDOR CEILINGS TO 12 FEET FOR PORTLAND CEMENT PLASTER AND 30 FEET FOR GYPSUM OR LIME PLASTER. UNRESTRAINED CEILING DESIGN SHALL BE INSTALLED WHEN TOTAL CEILING AREA EXCEEDS INTERVAL LIMITATIONS AS SPECIFIED ABOVE. CONTROL JOINTS FOR WALLS SHALL BE INSTALLED AS DETAILED ABOVE WITH METAL CONTROL JOINT APPLIED TO TWO WALL STUDS OR FURRING MEMBERS SPACED 3/16" APART. ALL CEILING AND WALL JOINTS SHALL BE INSTALLED WHERE SHOWN ON THE ARCHITECTURAL WALL ELEVATIONS AND THE FLOOR AND REFLECTED CEILING PLANS.

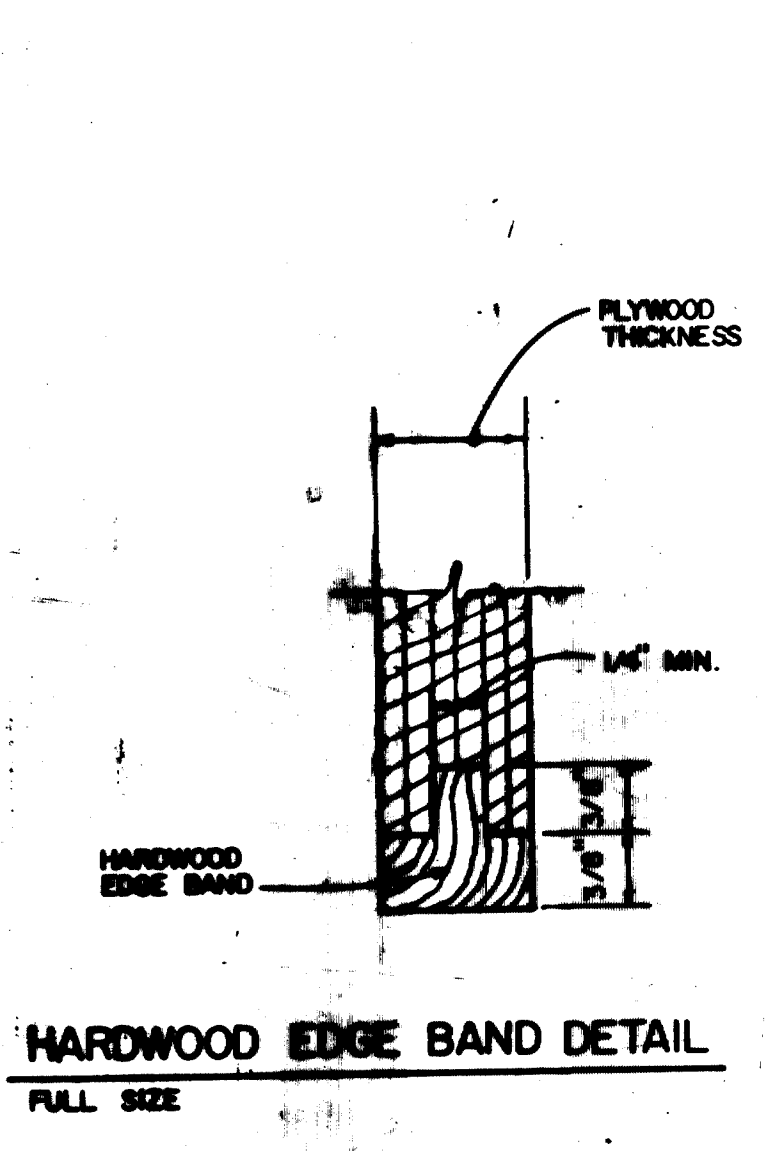

NOTE: PROVIDE HARDWOOD EDGE BANDING FOR EXPOSED EDGES OF PLYWOOD SHELVES & VERTICAL EDGES AND AROUND EDGES OF SQUARE EDGED PLYWOOD DOORS. EDGES OF OVERLAPPING-TYPE PLYWOOD DOORS WHICH HAVE BEEN REINFORCED AND GROGGED DO NOT REQUIRE EDGE BANDING.

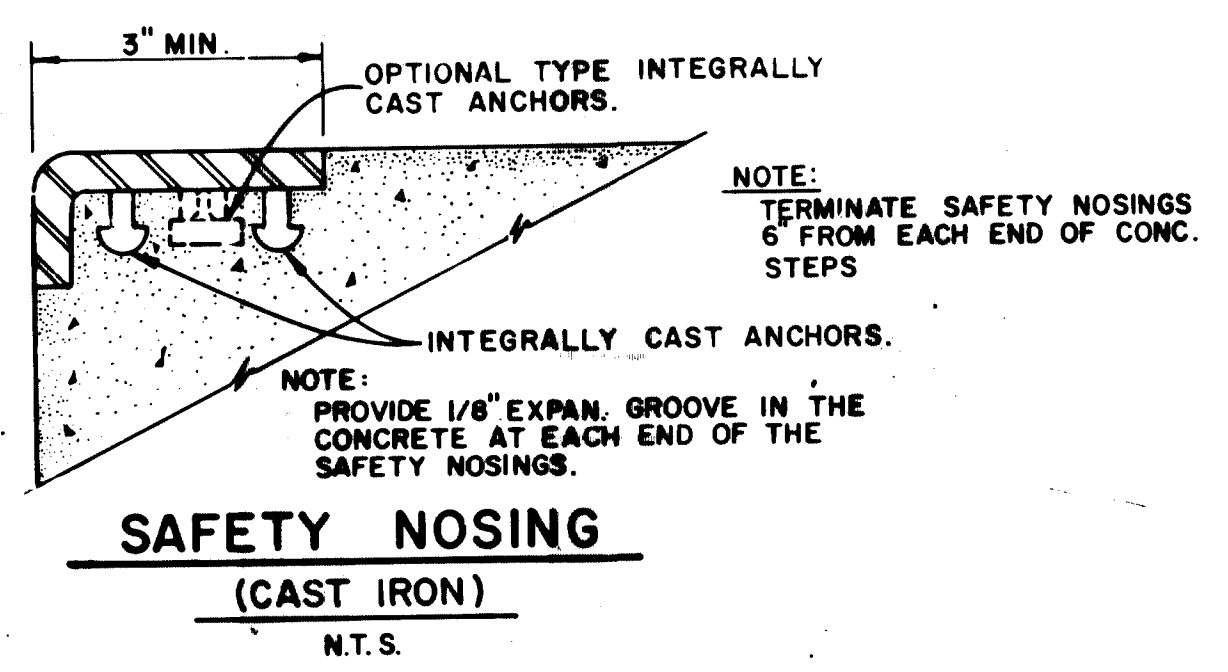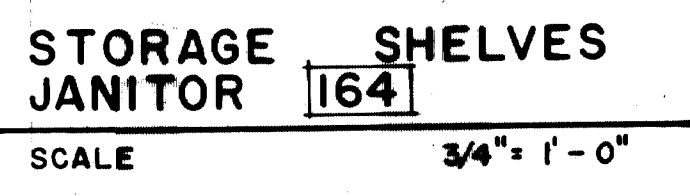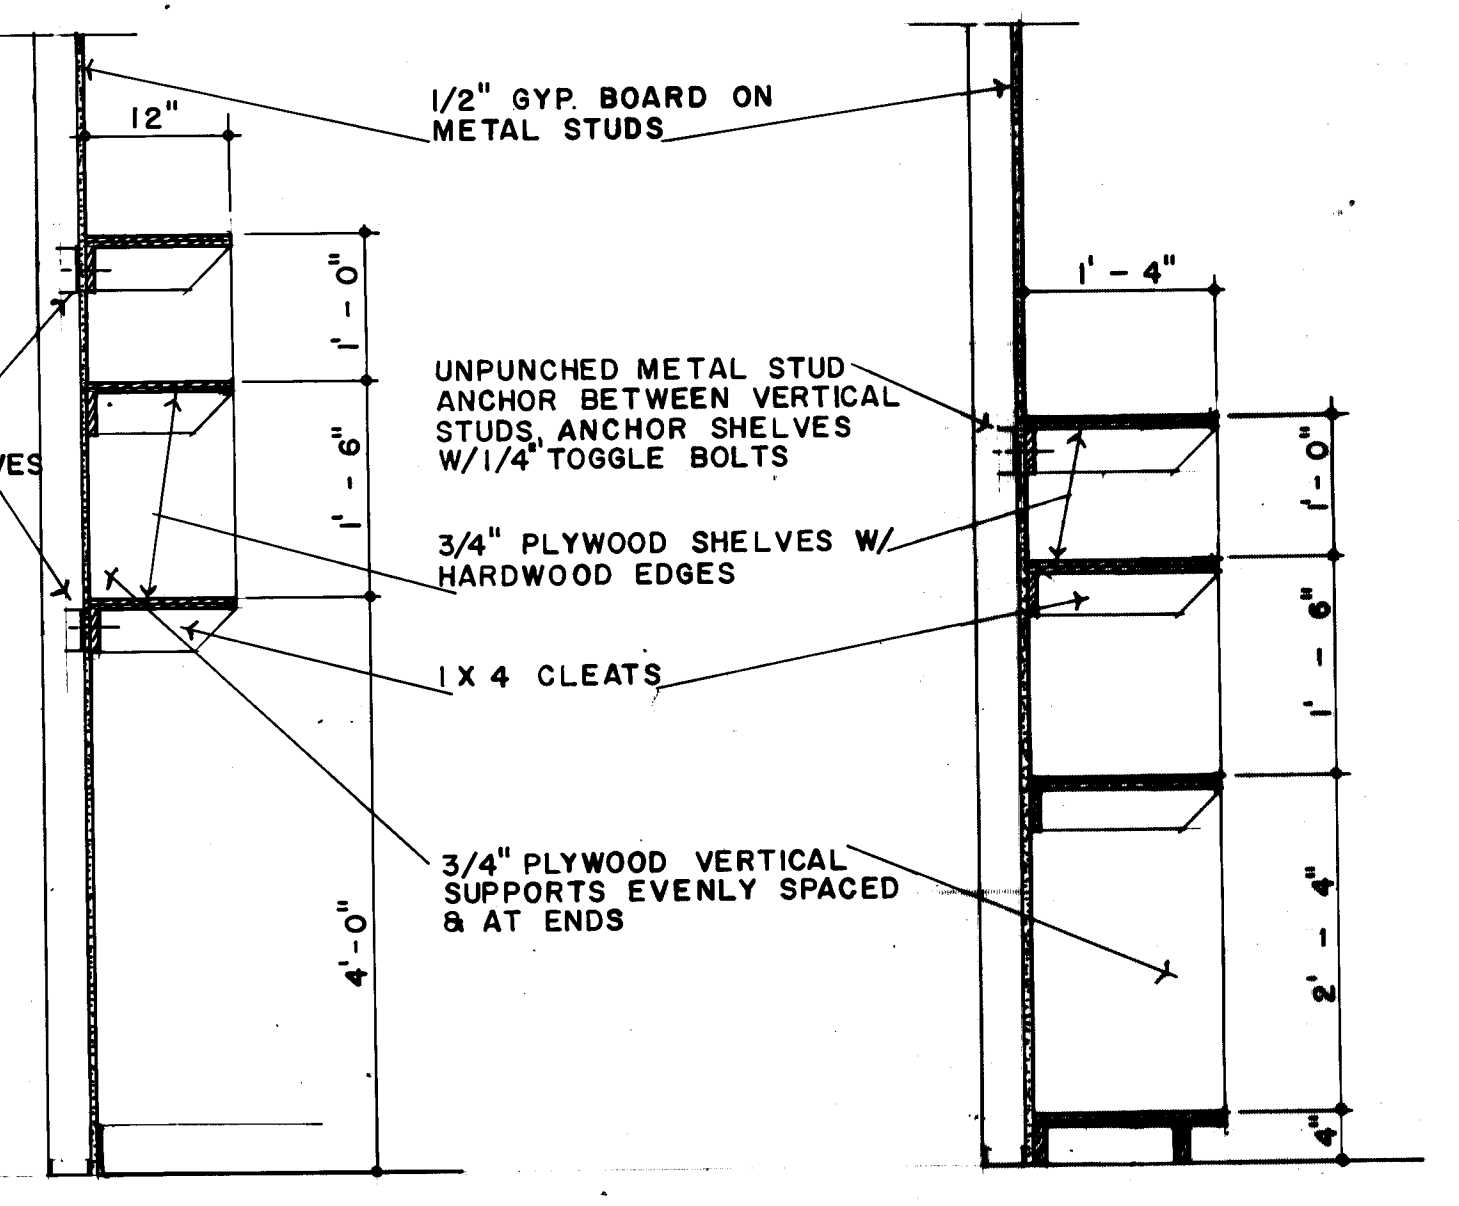


CEILING CONTROL JOINT DETAILS

WALL CONTROL JOINT SIMILAR



N.T.S.

DETAILED REQUIREMENTS FOR WALLS AND SUSPENDED CEILINGS


WHERE DUCTWORK OR OTHER EQUIPMENT IN ATTIC SPACES BETWEEN HUNG CEILING AND STRUCTURAL FRAMING CAN NOT BE ACCOMMODATED BETWEEN THE HANGER WIRES FOR THE CEILINGS, EXTRA STRUCTURAL SUB-FRAMING MEMBERS SHALL BE SUSPENDED FROM MAIN STRUCTURAL MEMBERS AND BELOW THE DUCTWORK OR OTHER EQUIPMENT TO SUPPORT THE HANGER WIRES. HANGER WIRE SPACING IS 4'-0" O.C. MAXIMUM IN BOTH DIRECTIONS FOR ADJUSTABLE TILE CEILING, MAXIMUM SPACINGS OF 4'-0" O.C. IN BOTH DIRECTIONS OR 4'-0" O.C. IN ONE DIRECTION AND 3'-0" O.C. IN THE OTHER DIRECTION FOR PLASTER CEILINGS, AND VARIES FROM 2'-6" TO 3'-6" O.C. MAXIMUM IN ONE DIRECTION AND FROM 4'-0" TO 8'-0" O.C. MAXIMUM IN THE OTHER DIRECTION FOR GYPSUM BOARD CEILINGS. SEE CEILING SUSPENSION DETAILS AND SPECIFICATIONS FOR REQUIRED SUSPENDED CEILING TYPES AND REQUIREMENTS FOR HANGER WIRES.

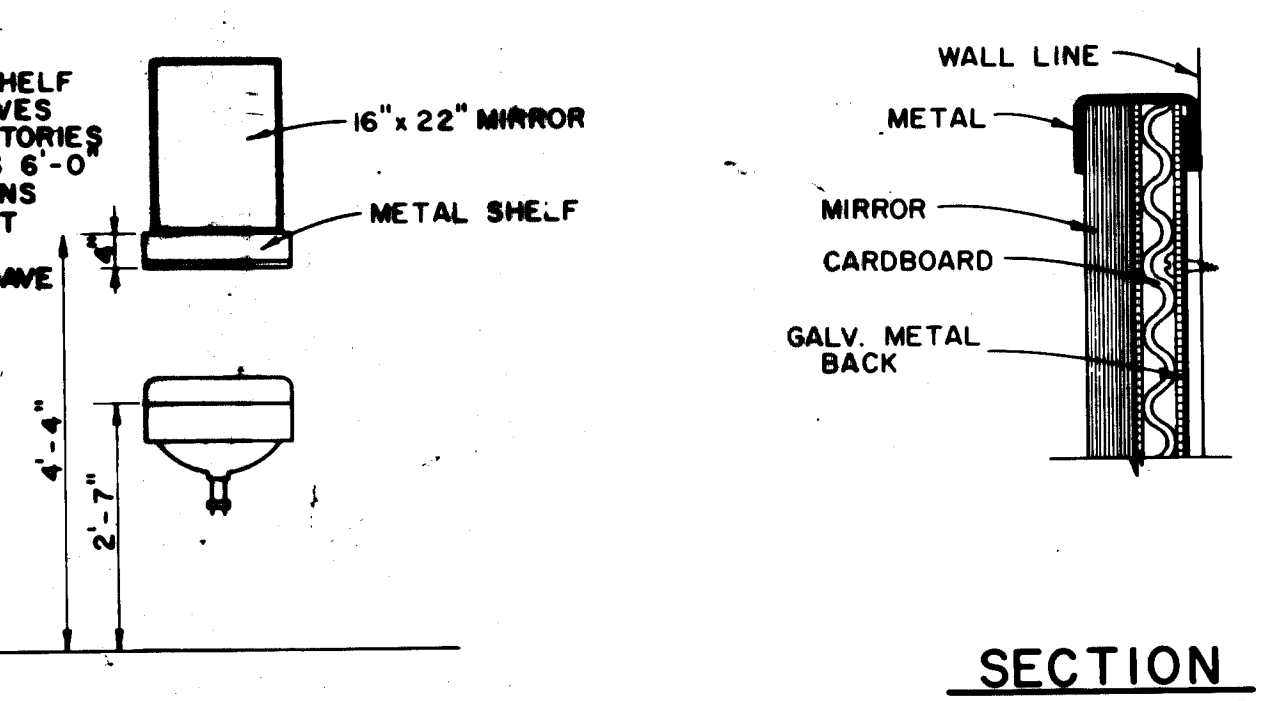


SHELF & MIRROR DETAILS

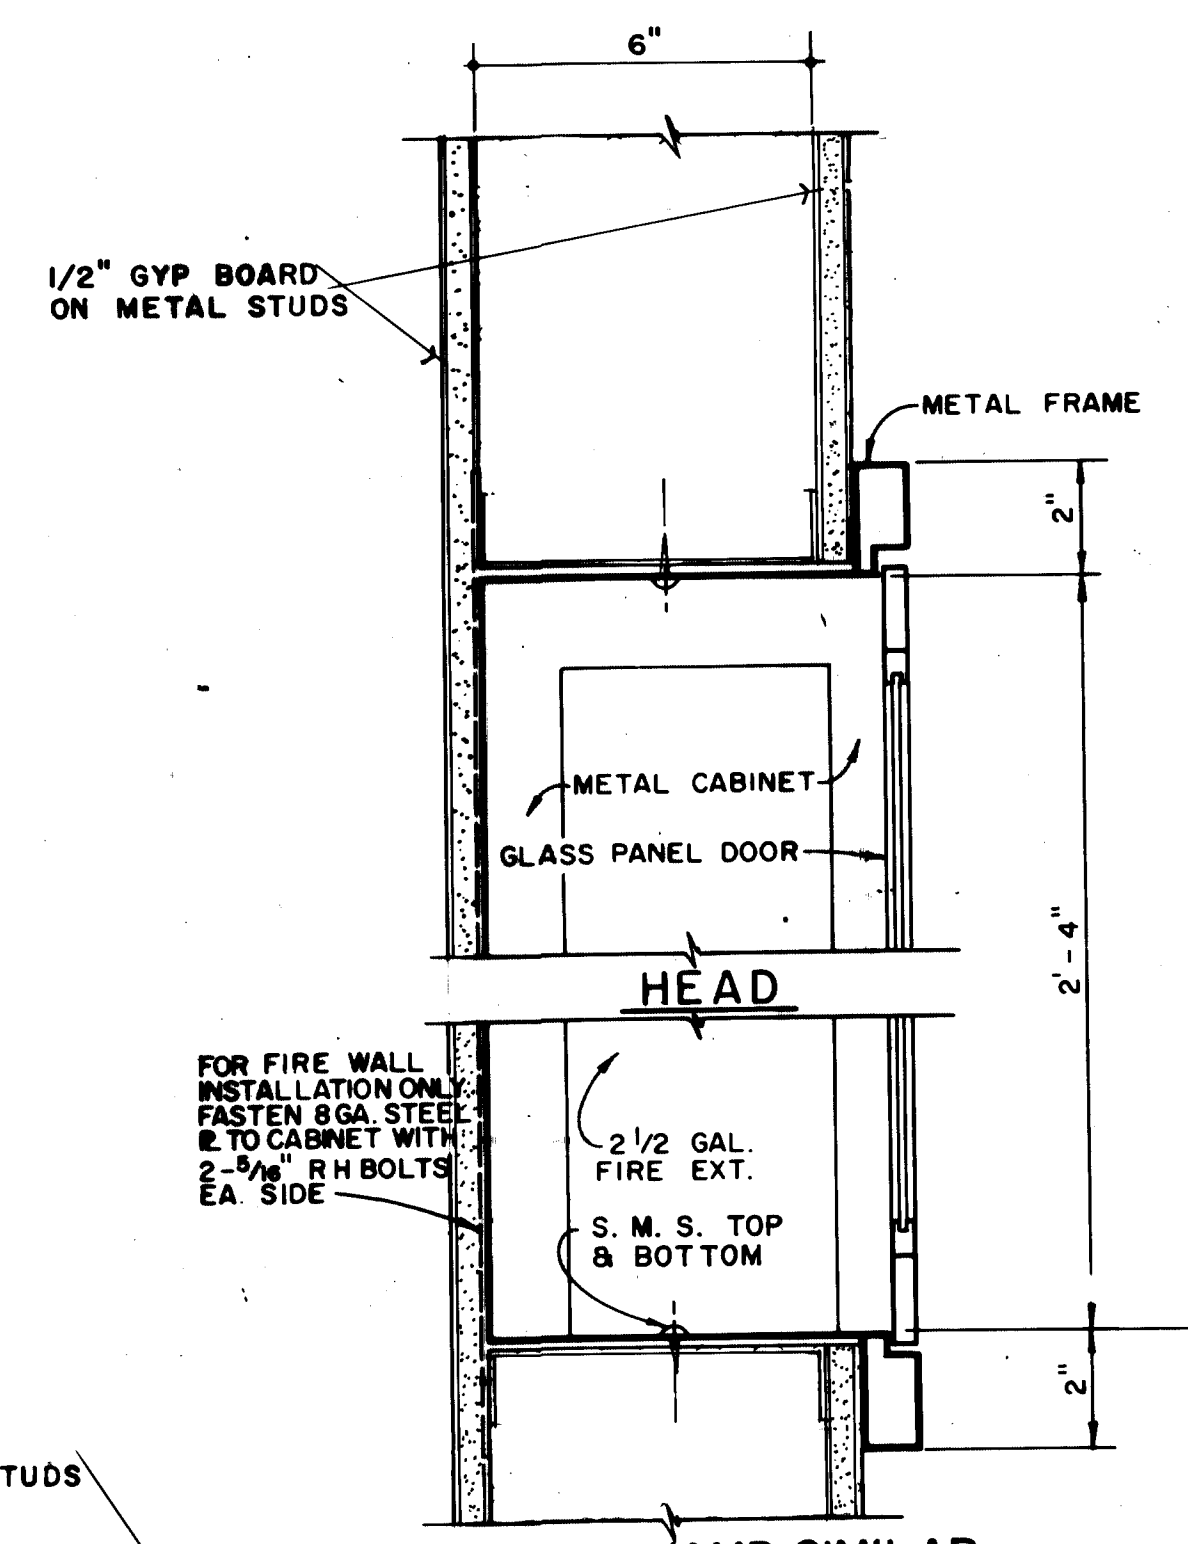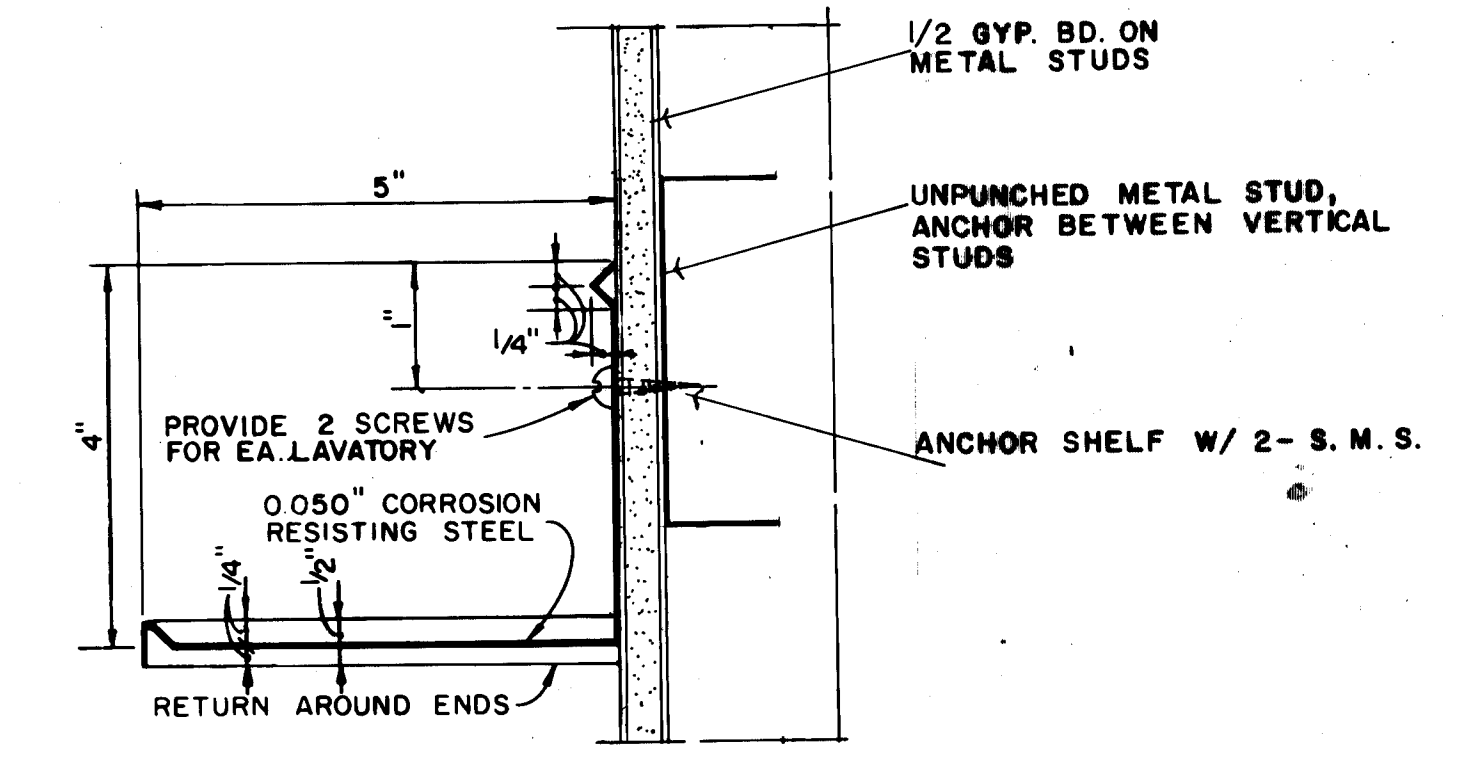

FIRE EXTINGUISHER CABINET DETAILS

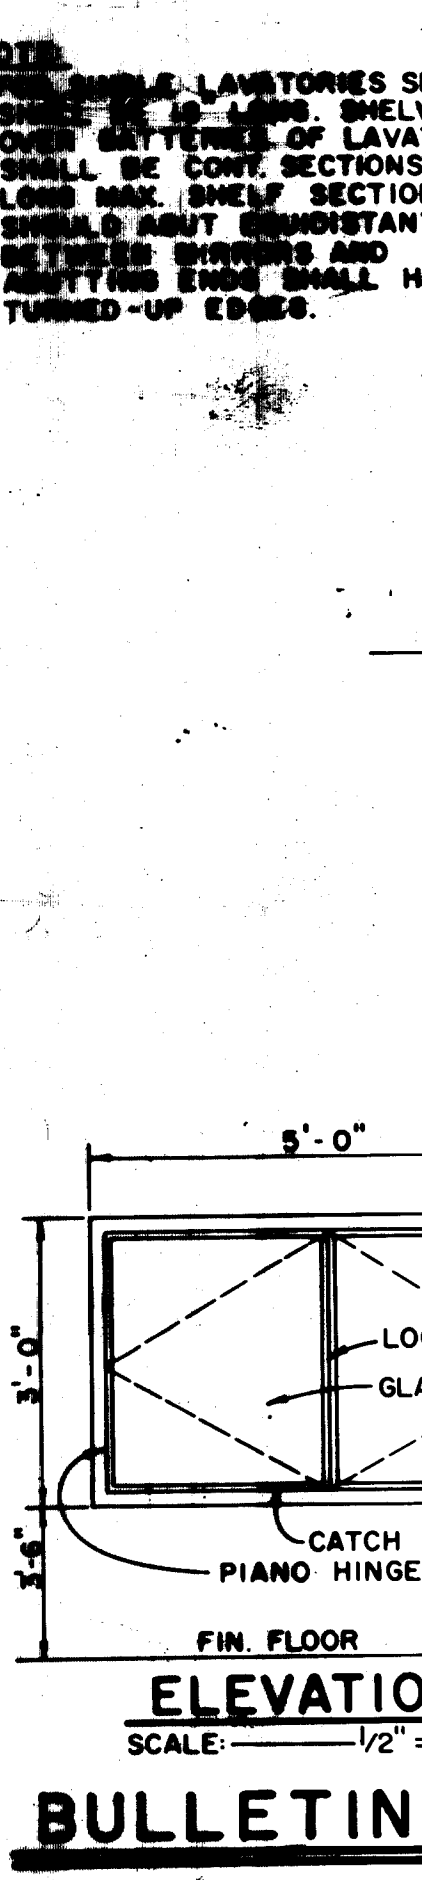

BULLETIN BOARD DETAILS

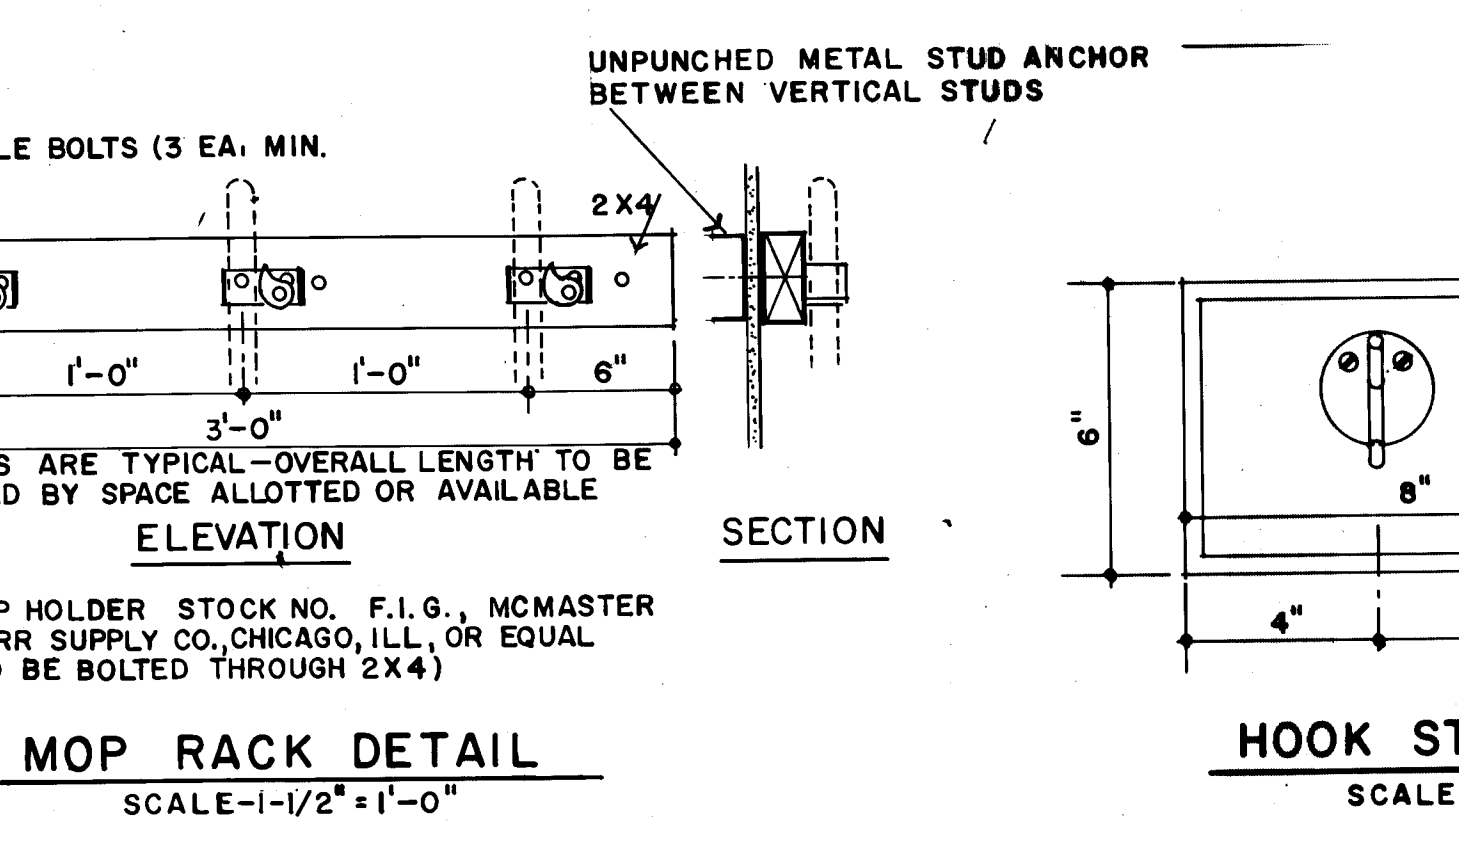

HOOK STRIP DETAIL

SCALE: 3/4" = 1'-0"

6"

4"

8"

5"


UNPUNCHED METAL STUD, ANCHOR BETWEEN VERTICAL STUDS

1/2" GYP. BOARD ON METAL STUDS

UNPUNCHED METAL STUD, ANCHOR BETWEEN VERTICAL STUDS

3" - 2 SCREW COAT HOOK

ANCHOR HOOK W/ S.M.S. TO HORIZ. METAL STUD

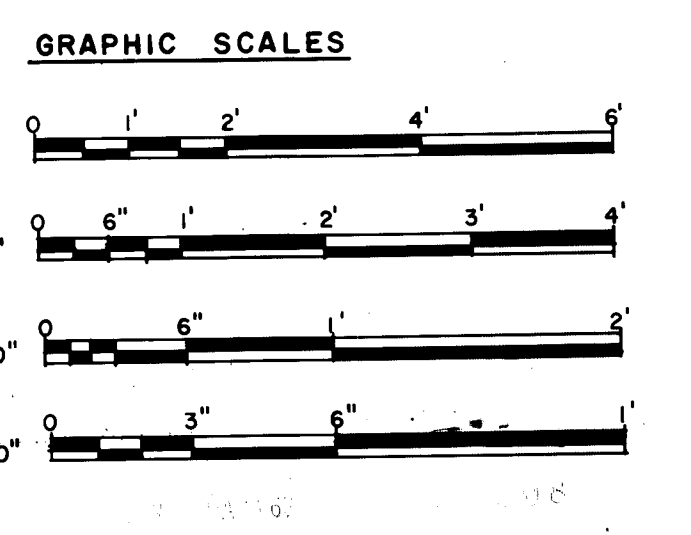

DESIGNED BY:	REESE AIR FORCE BASE, TEXAS
DRAWN BY:	F.W.D.
CHECKED BY:	F.W.D.
SUBMITTED BY:	A.C.S.
ENGINEER:	
CONTR. NO.	INV. NO. DMD63-13-B-0158
DRAWING NUMBER	31-02-01
SHEET NO.	31 OF 45
SEQUENCE NO.	44
DATE: MAR 1953	
AIR FORCE 1 OF 3	